


NOTES:

1. PLACEMENT OF THE STOP BOX CAN VARY FROM A MAXIMUM OF 5 FEET OUTSIDE THE PROPERTY LINE TO A MINIMUM OF 5 FEET INSIDE THE PROPERTY LINE. PLACEMENT OF THE STOP BOX OUTSIDE THE PROPERTY LINE IS PREFERRED.
2. OWNER'S RESPONSIBILITY FOR REPAIR, INCLUDING LEAK REPAIR, SHALL EXTEND TO, BUT NOT INCLUDING, THE CORPORATION STOP.
3. DENVER WATER TO MAKE TAPS 2" AND SMALLER. DENVER WATER TO INSTALL METER.
4. SERVICE LINE INCLUDING METER PIT TO BE INSPECTED BY BEAR CREEK INSPECTOR AND DENVER WATER.
5. IF THERE IS A TREE LAWN, BOTH CURB STOP AND METER PIT MUST BE LOCATED BETWEEN CURB AND SIDEWALK.
6. STOP BOX SHALL BE LOCATED IN LANDSCAPE AREA, 24" FROM THE INLET SIDE OF THE METER PIT.
7. NO BENDS, FITTINGS, CONNECTIONS, OR CHANGES IN PIPE SIZE ARE PERMITTED BETWEEN THE TAP AND 5 FEET PAST THE METER PIT.

SHOULD ANY SITUATION ARISE OTHER THAN SHOWN CONCERNING THE DEPTH OR OBSTRUCTION OF SERVICE LINE OR THE PLACEMENT OF METER PIT OR STOP BOX CALL FIELD INSPECTOR OR FIELD SUPERVISOR.

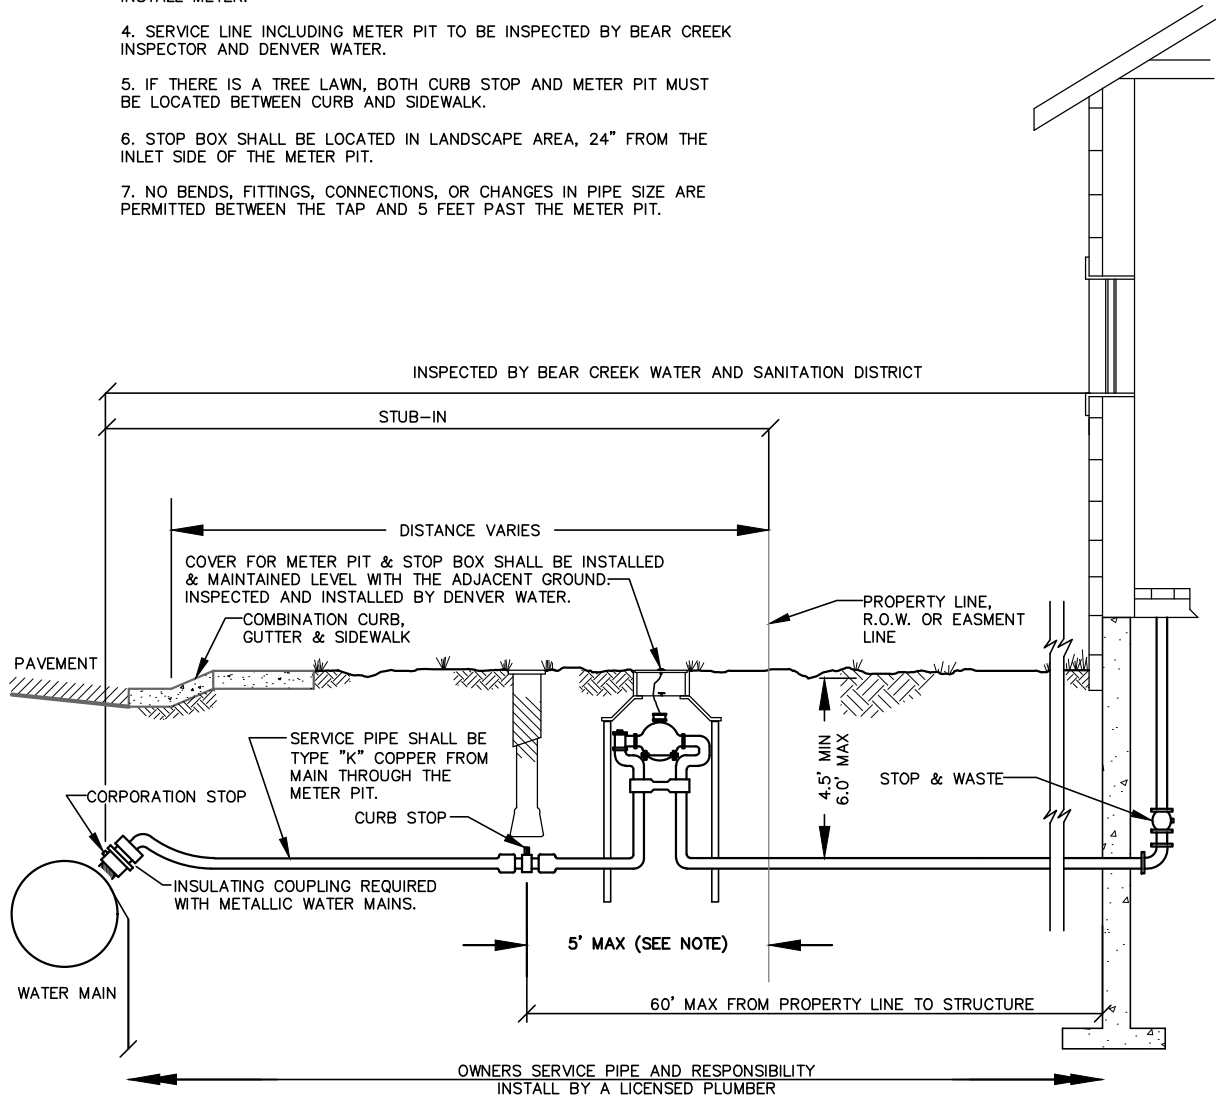

BEAR CREEK WATER & SANITATION DISTRICT		
WATER SERVICE LINE 3/4" AND 1"		
Scale: <u>None</u>	Date: <u>Junel 2021</u>	
Drawn: <u>LDL</u>	Ck: <u>BJF</u>	
Approved: <u>Barney J. Fix</u>		